


NOTES:

- A. ALL JOINTS TO BE RESTRAINED. (SEE ITEM 5 OF APPROVED MATERIALS LIST) Δ
- B. SEE SHEET 2 OF 2 FOR CONSTRUCTION NOTES. $\#$

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV.	DATE	BY	3" DOMESTIC SERVICE	W-04
2	9/18/14	STAFF		
1	10/16/08	STAFF	BRIAN W GENGLER, CITY ENGINEER	SHEET 1 OF 2

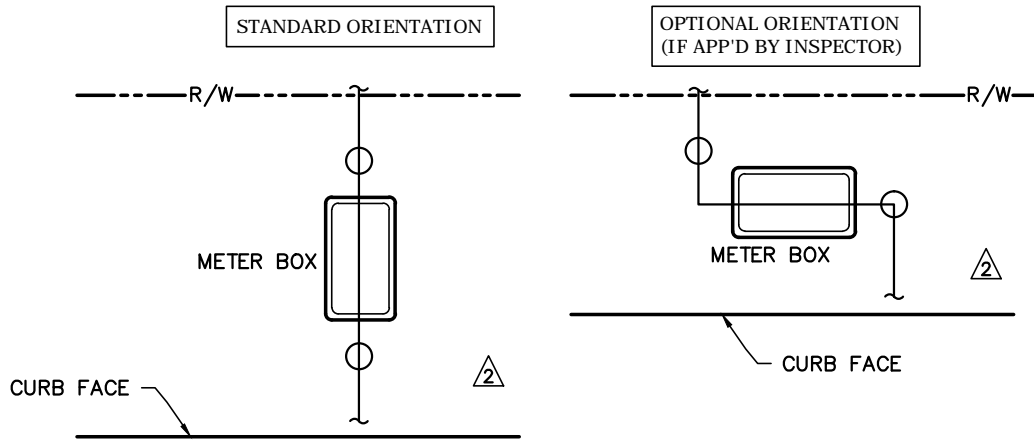

2

CONSTRUCTION NOTES

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	6" TAPPING SLEEVE	7-A
2	6" GATE VALVE (FL x FL) W/ VALVE CAN ASSEMBLY	2-B
3	6" x 4" ECCENTRIC REDUCER (FL X MJ), INSTALL WITH TOP LEVEL	6-C
4	4" DIP PIPE	1-C
5	4" - 3" REDUCING 90° BEND (MJ)	6-C
6	3" PE SPOOL, CUT TO FIT	6-E
7	3" 90° BEND (MJ x FL) GRIP RING PACK	6-C
8	NOT REQUIRED	
9	NOT REQUIRED	
10	3" FL x FL GATE VALVE W/ OPERATING NUT	2-B
11	3" OCTAVE METER	13-C
12	3" FL SPOOL	6-E
13	#8 METER BOX LID + COVER	9-E
14	3" STRAINER	13-L

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV.	DATE	BY	3" DOMESTIC SERVICE	W-04
2	9/18/14	STAFF		
1	8/13/08	STAFF	BRIAN W GENGLER, CITY ENGINEER	SHEET 2 OF 2