

NOTES:

- A. IF CONNECTING TO A 6" MAIN LINE, THE CITY MAY REQUIRE AN AIR VAC TO BE ² INSTALLED ON METER ASSEMBLY. SEE STD. DWG. W-24 FOR DETAIL.
- B. ANY PENETRATIONS THROUGH VAULT SHALL BE DRY PACKED. ²
- C. RESTRAIN ALL JOINTS. (SEE ITEM 5 ON APPROVED MATERIALS LIST) ²
- D. IF ANY PART OF THIS ASSEMBLY IS OUTSIDE THE PUBLIC RIGHT-OF-WAY, OWNER MUST DEDICATE TO VWD A 5' EASEMENT ON ALL SIDES.
- E. SEE SHEET 2 OF 2 FOR CONSTRUCTION NOTES. (#)

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT


REV.	DATE	BY
2	9/18/14	STAFF
1	10/16/08	STAFF

4" DOMESTIC SERVICE

BRIAN W GENGLER, CITY ENGINEER

W-05

SHEET 1 OF 2

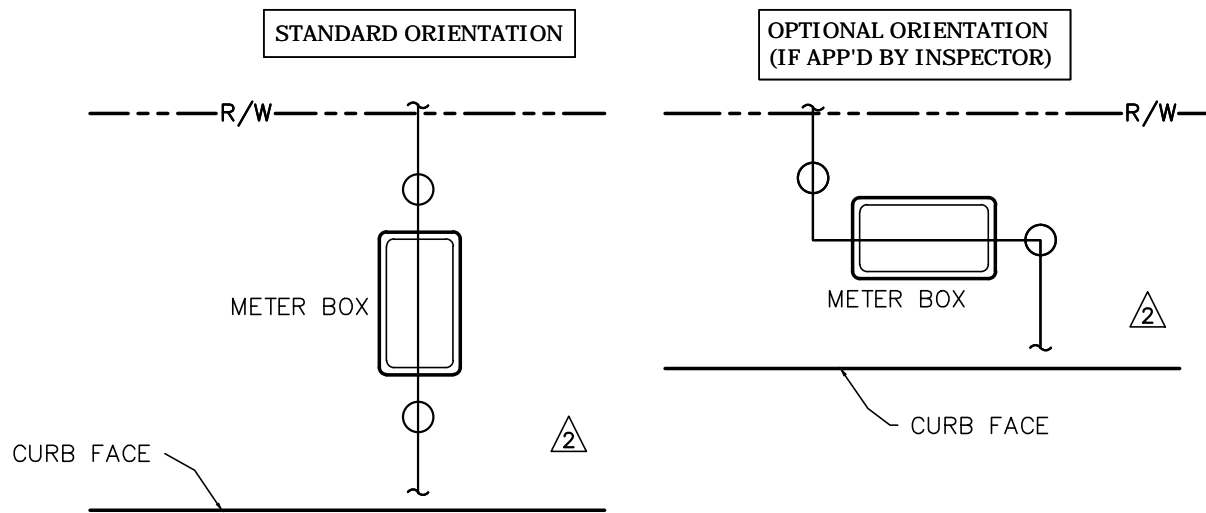

2

CONSTRUCTION NOTES

ITEM	DESCRIPTION	APPROVED MATERIAL LIST NUMBER
1	6" TAPPING SLEEVE	7-A
2	6" GATE VALVE (FL x FL) W/ VALVE CAN ASSEMBLY	2-B
3	6" x 4" ECCENTRIC REDUCER (INSTALL WITH TOP LEVEL)	6-C
4	4" DIP PIPE	1-C
5	4" MJ x MJ 90° BEND	6-C
6	4" 90° BEND (MJ x FL) GRIP RING PACK	6-C
7	4" FL x FL GATE VALVE W/ OPERATING NUT	2-B
8	4" OCTAVE METER	13-C
9	#8 METER BOX LID & COVER	9-E
10	4" x 13" FL x FL SPOOL	6-E
11	4" FL SPOOL	6-E
12	4" STRAINER	13-L

CITY OF VICTORVILLE - ENGINEERING DEPARTMENT

REV.	DATE	BY	4" DOMESTIC SERVICE	W-05
2	9/18/14	STAFF		
1	8/13/08	STAFF	BRIAN W. GENGLER, CITY ENGINEER	SHEET 2 OF 2